


190111 lbw TP vs time while tightning sbc2 if/lo cables downstairs



PoIB

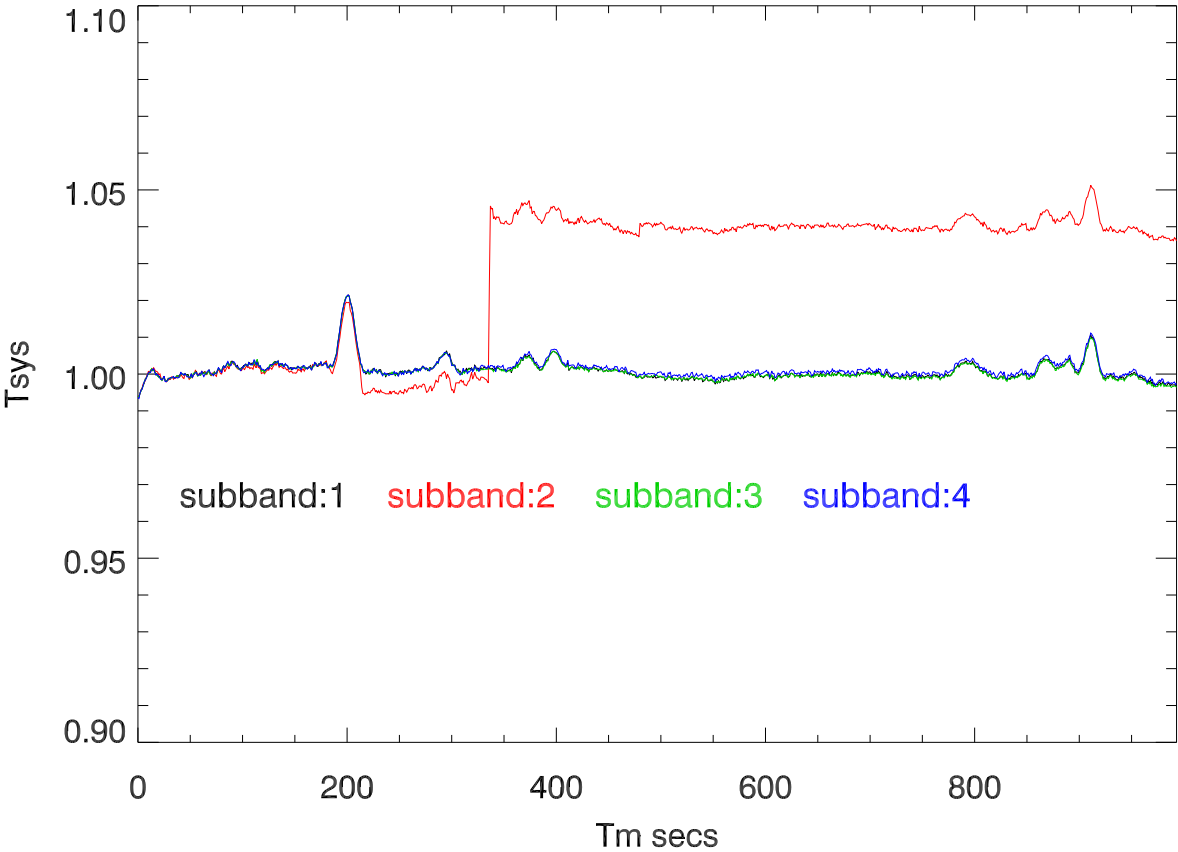